# Status of Wastewater Treatment Facilities under Regulation #85

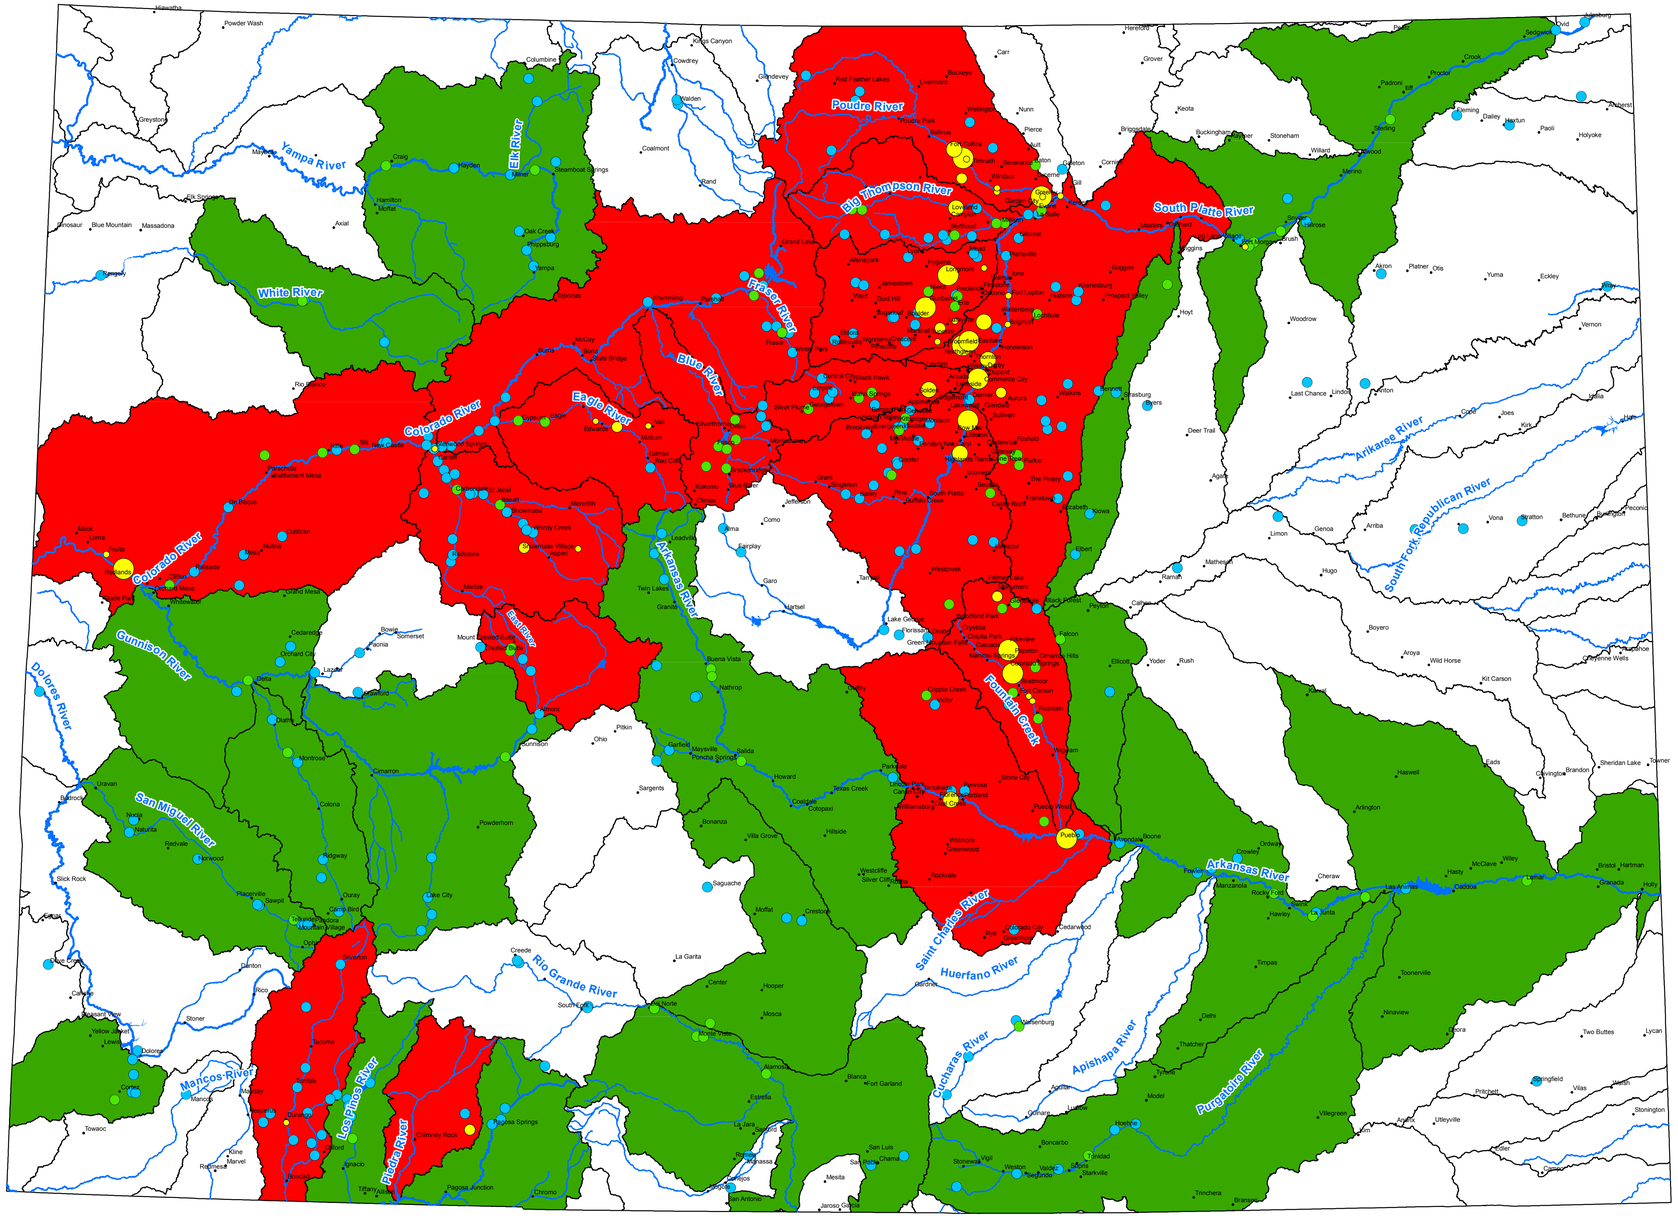


## Legend

### NonExempt Facilities

**Flow Million Gallons per Day (MGD)**

- Below 3
- 3 to 5
- 5 to 10
- Above 10

### Delayed NonExempt Facilities

### Exempt Facilities

### Hydrologic Unit Code (8)

**Flow per Square Mile (mgd)**

- Delayed Watershed
- Priority Watershed
- No Discharge or Regulated Plant

N
W E
S

Date: 3/28/2012
Author: Scott McGowan
Path: L:\Project\NutrientDischargers\HUCSWWTPnew.mxd

50 25 0 50 Miles

Use constraints: There are no restrictions and legal prerequisites for using this data set. The state of Colorado assumes no liability to the completeness, correctness, or fitness for use of this data set.

Colorado Department of Public Health and Environment